

AIR CONDITIONING DISCONNECT

INSTALLATION INSTRUCTIONS

For Fused Models



DAHENG ELECTRIC

HVAC Electrical Products Manufacturer

INSTALLATION INSTRUCTIONS

WARNING

Risk of Electrical Shock.

Disconnect all power before installation.

Installation must be performed by a qualified electrician.

Follow all applicable local electrical codes and regulations.

SAFETY NOTES

- Verify product rating before wiring.
- Ground enclosure properly.
- Inspect enclosure and pull-out assembly before installation.
- Follow local electrical codes.
- Use appropriate PPE.


TOOLS REQUIRED

- Drill tool
- Flat head screwdriver

INSTALLATION

- 1 Open the cover and slide it to lock in position.
- 2 Remove the front panel and pull-out plug.
- 3 Knock out the needed conduit entries in the desired size.
- 4 Drill a mounting screw into the wall to hang the box.
- 5 Secure the box with 1 to 3 additional screws.
- 6 Please use the wiring diagram and information on the back of the front panel.
- 7 Install appropriate rated fuse as per marking.
- 8 Install the front panel and then the pull-out plug in the ON position.


INSTALLATION REFERENCE DIAGRAM

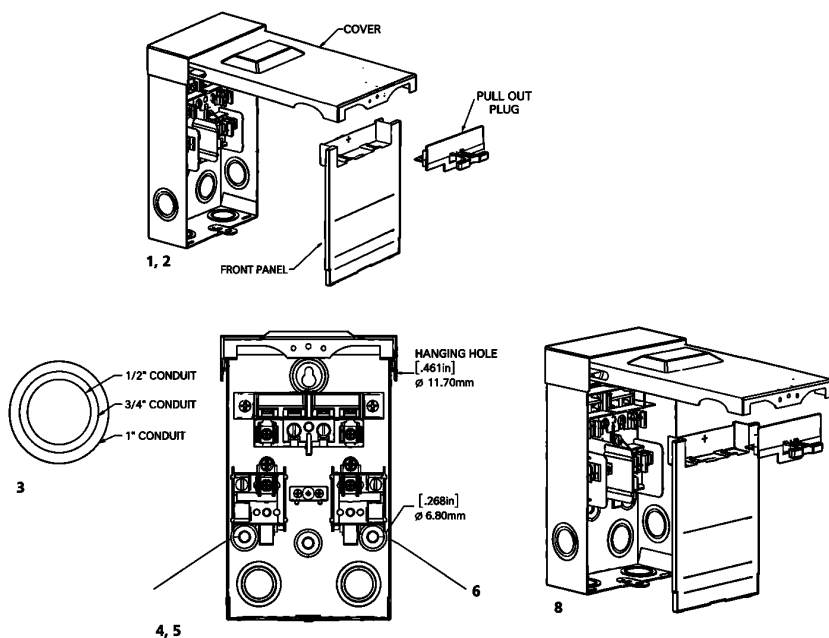

MAINTENANCE

PULL-OUT OFF / LOCKOUT PROCEDURE

- 1 Remove pull-out assembly.
- 2 Reverse pull-out assembly and insert into OFF position.
- 3 Lock enclosure if required.

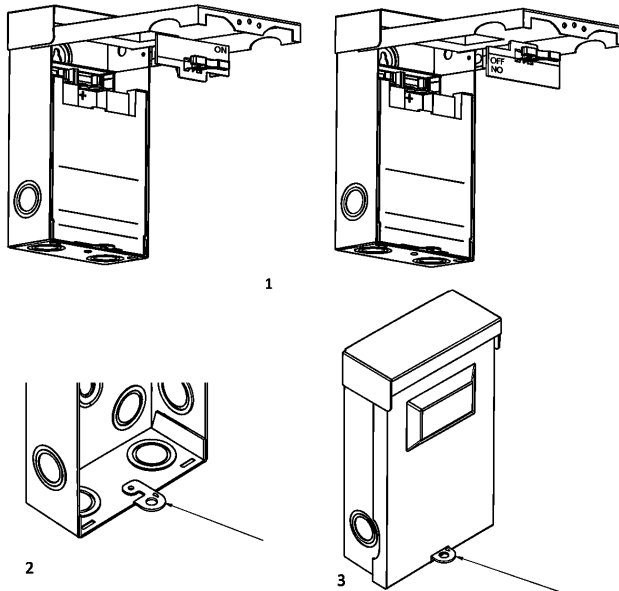

PERIODIC INSPECTION NOTES

- Inspect enclosure condition periodically.
- Confirm cover and pull-out assembly operate properly.
- Check electrical connections for signs of overheating or damage.
- Replace damaged components immediately.

DAHENG ELECTRIC

Manufacturer of HVAC Disconnects and Electrical Products

Website: www.dahengelectric.com

Made in China

Email: sales@dahengelectric.com

Yueqing Daheng Electrical Co., Ltd.



Scan For

Product Information

Installation Guide

OEM Services