

AIR CONDITIONING DISCONNECT

INSTALLATION INSTRUCTIONS

For Non-Fused Models



DAHENG ELECTRIC

HVAC Electrical Products Manufacturer

INSTALLATION INSTRUCTIONS

WARNING

Risk of Electrical Shock.

Disconnect all power before installation.

Installation must be performed by a qualified electrician.

Follow all applicable local electrical codes and regulations.

SAFETY NOTES

- Verify product rating before wiring.
- Ground enclosure properly.
- Inspect enclosure and pull-out assembly before installation.
- Follow local electrical codes.
- Use appropriate PPE.


TOOLS REQUIRED

- Drill
- Flat head screwdriver
- Mounting screws
- Conduit fittings

INSTALLATION

- 1 Open cover and secure in open position.
- 2 Remove front panel and pull-out assembly.
- 3 Open required conduit knockouts.
- 4 Mount enclosure securely to wall.
- 5 Connect LINE and LOAD conductors according to applicable codes.
- 6 Reinstall front panel.
- 7 Insert pull-out assembly into ON position.


INSTALLATION REFERENCE DIAGRAM

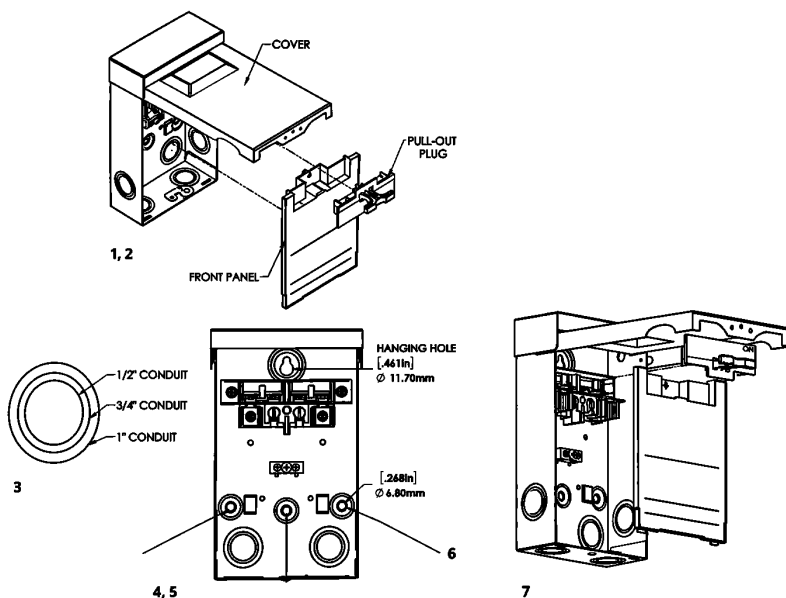

MAINTENANCE

PULL-OUT OFF / LOCKOUT PROCEDURE

- 1 Remove pull-out assembly.
- 2 Reverse pull-out assembly and insert into OFF position.
- 3 Lock enclosure if required.

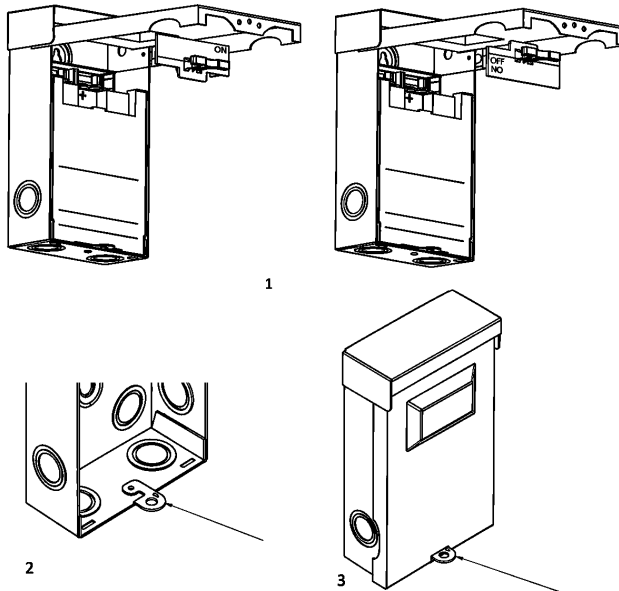

PERIODIC INSPECTION NOTES

- Inspect enclosure condition periodically.
- Confirm cover and pull-out assembly operate properly.
- Check electrical connections for signs of overheating or damage.
- Replace damaged components immediately.

DAHENG ELECTRIC

Manufacturer of HVAC Disconnects and Electrical Products

Website: www.dahengelectric.com

Made in China

Email: sales@dahengelectric.com

Yueqing Daheng Electrical Co., Ltd.



Scan For

Product Information

Installation Guide

OEM Services